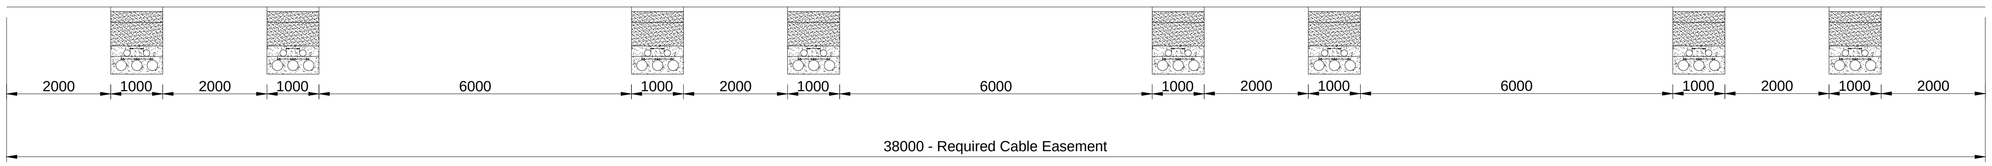

Overall cable trench for 4 x 220kV cable circuits

Scale: NTS

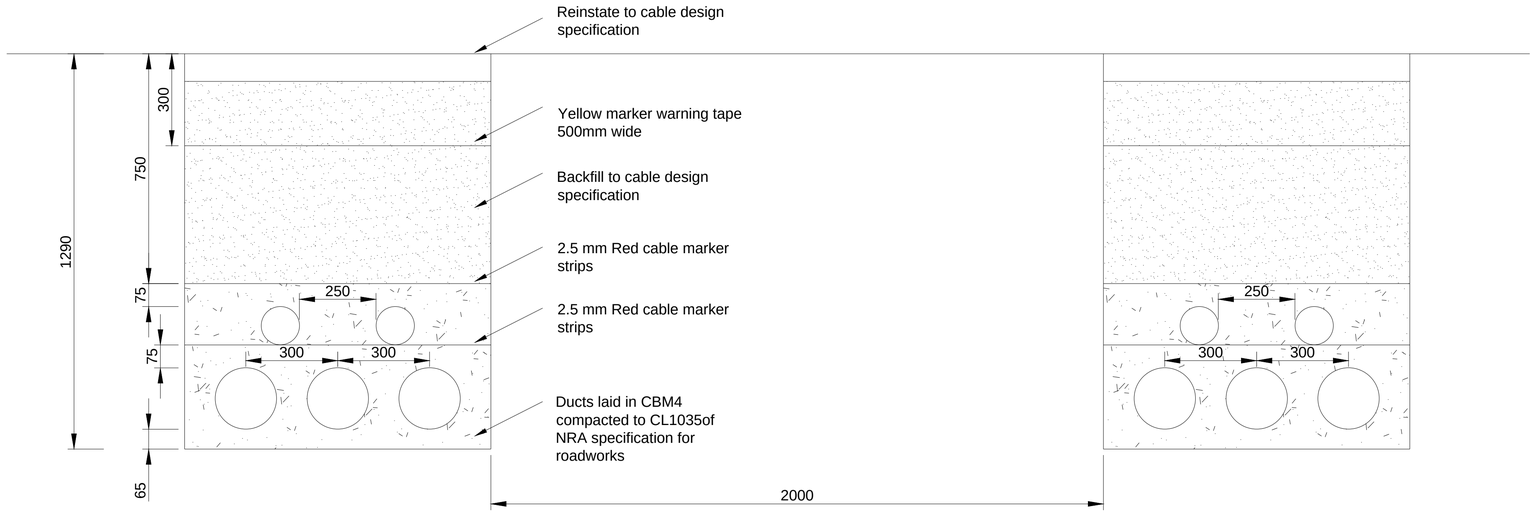

Detailed Trench Section for one 220kV cable circuit

Scale: 1:10

© Mott MacDonald Ireland

This document is issued for the party which commissioned it and for specific purposes connected with the captioned project only. It should not be relied upon by any other party or used for any other purpose.
We accept no responsibility for the consequences of this document being relied upon by any other party, or being used for any other purpose, or containing any error or omission which is due to an error or omission in data supplied to us by other parties.

Notes

1. Design for Planning Purposes, not for Construction.
2. All Dimension in millimetres

Key to symbols

0 0.5m 1m
1:10

Reference drawings

Rev	Date	Drawn	Description	Ch'k'd	App'd
02A	29/01/2016	CT	Issued for Planning	TK	TK
01A	18/12/2015	CT	Issued for Planning	TK	TK

Mott MacDonald
South Block
Rockfield
Dundrum
Dublin, 16
Ireland
T +353 (0) 1 2916700
F +353 (0) 1 2916747
W www.mottmac.com

Client
Apple Distribution International

Title
Caraunduff 220kV Substation
220kV Underground Cable Design
Trench Details

Designed	D.McCormack		Eng check	T.Keane	
Drawn	C.Thian		Coordination	D.McCormack	
Dwg check	M. McCarthy		Approved	T.Keane	

Scale at A1	Status	Rev	Security
as shown	APR	02A	STD

Drawing Number
MMD-360988-E-DR-03-XX-9307

P:\Dublin\MPD\360988 - Data Centre (Temp for CAD Files)\02 Temp Working Files\Planning Drawings\MMD-360988-E-DR-03-XX-9307_02A.dwg Jan 7, 2016 - 4:11PM thi73557