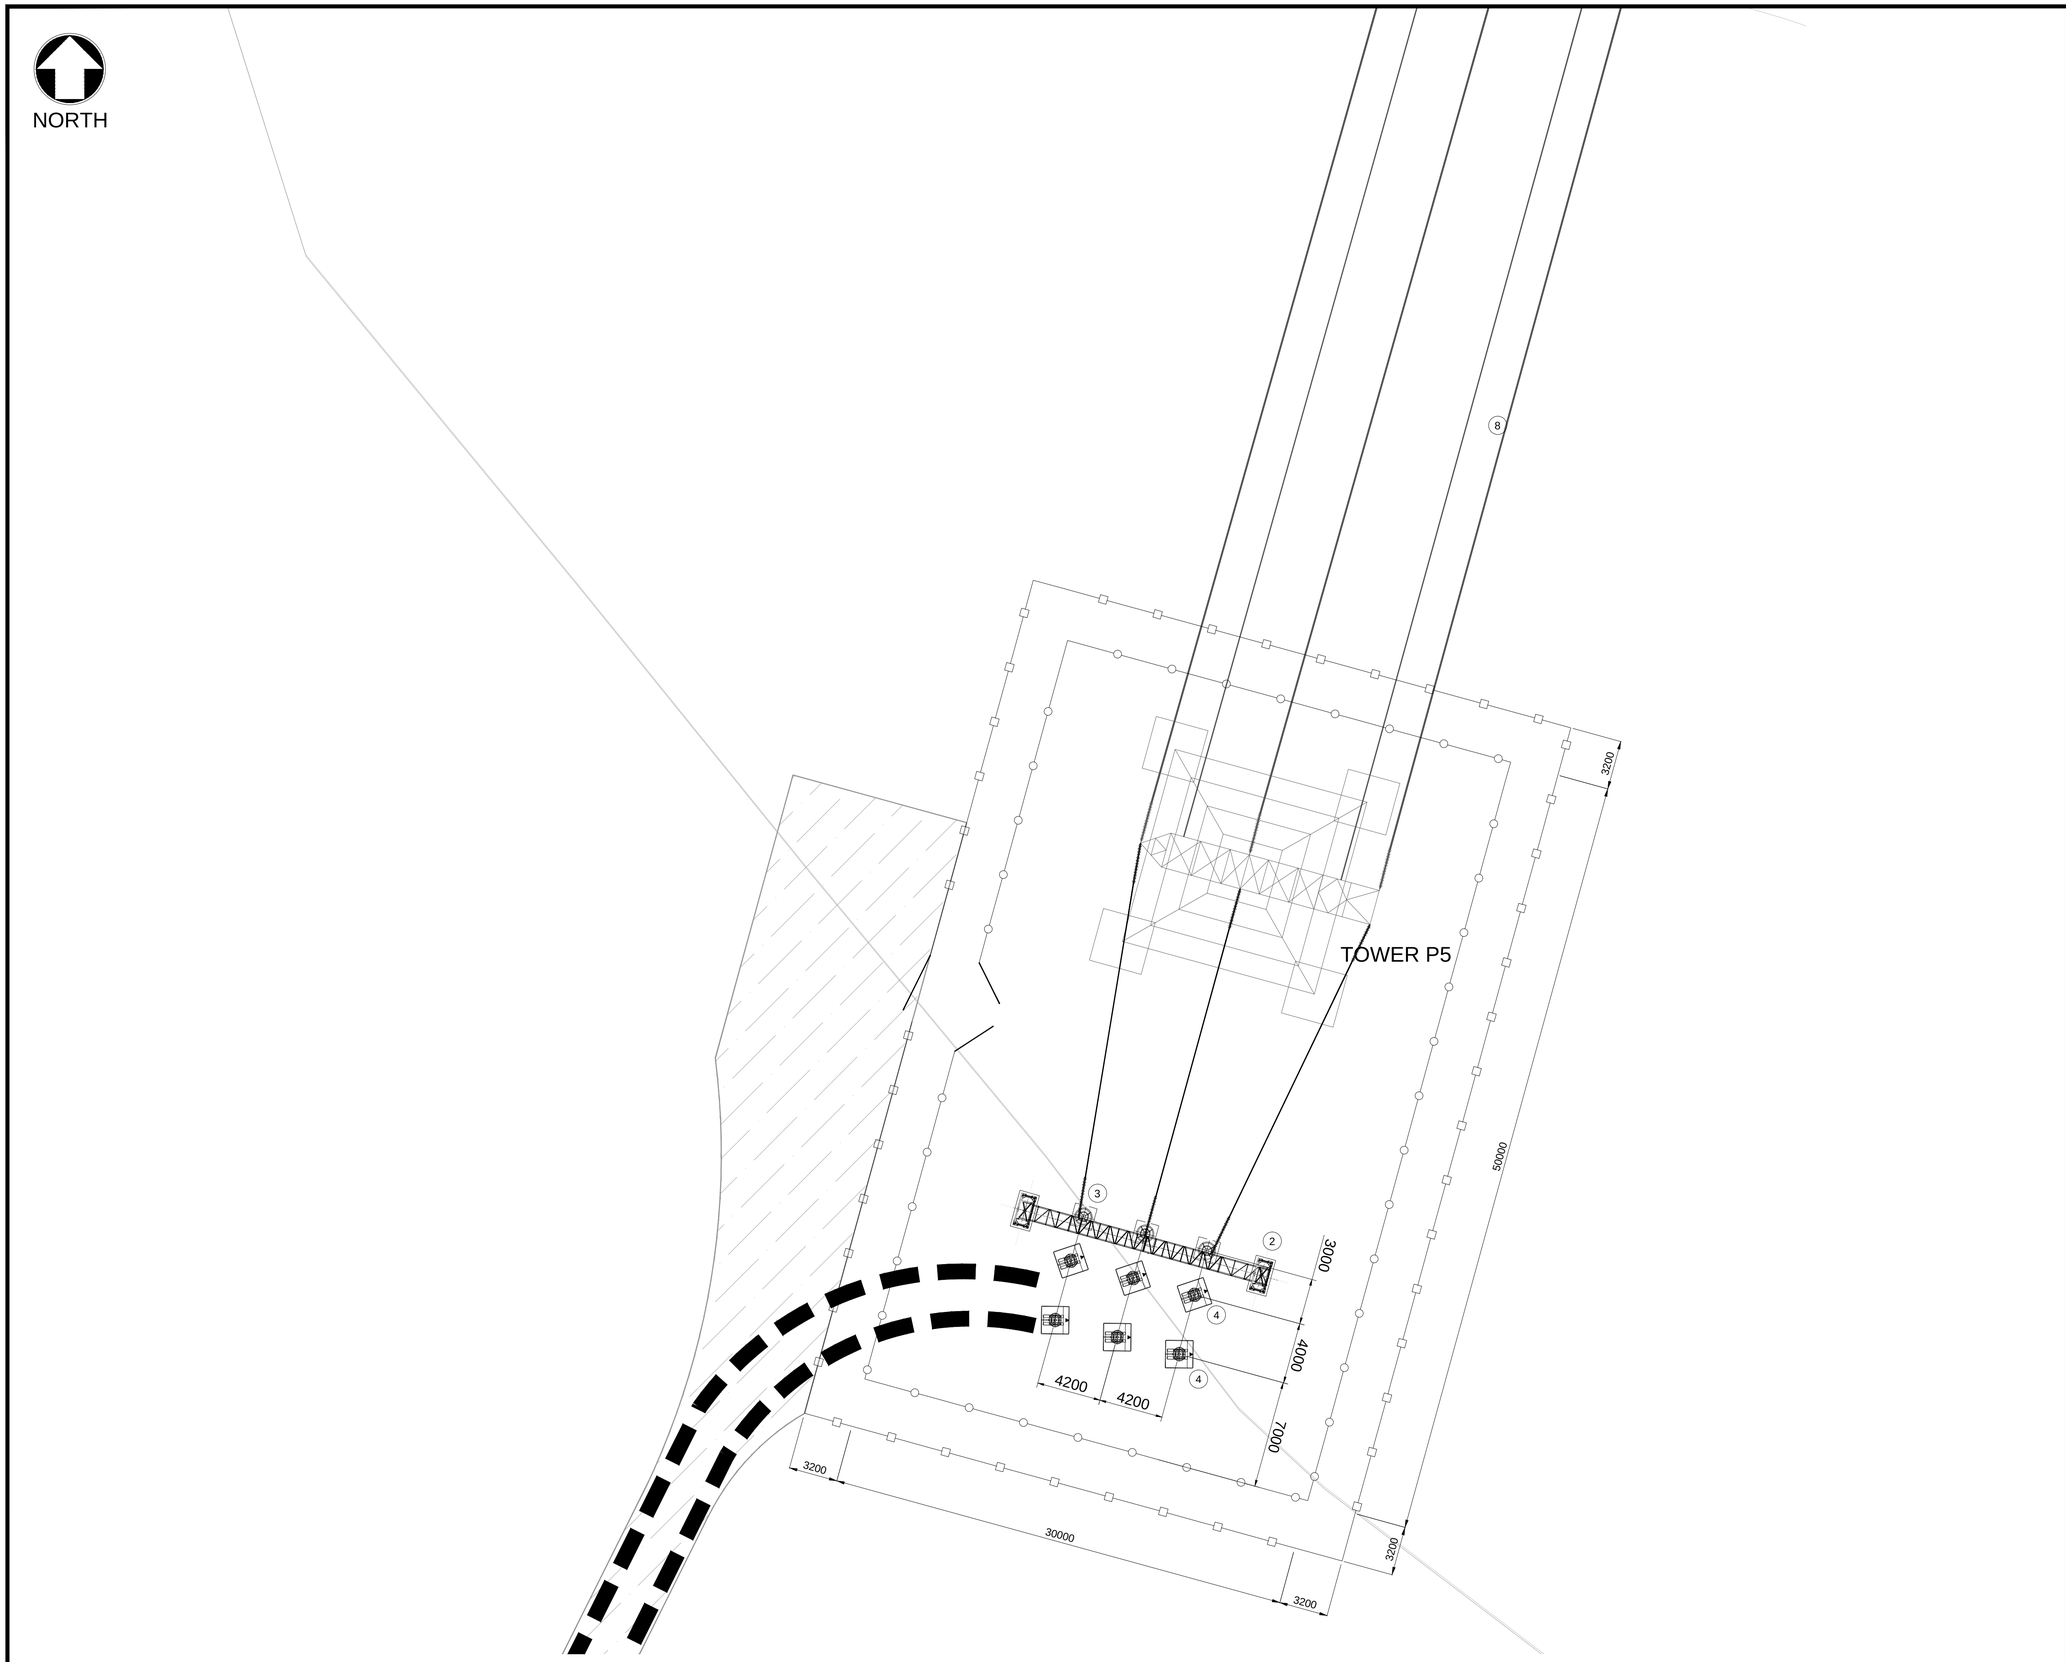

Notes

1. ©Ordnance Survey Ireland/Government of Ireland. Ordnance Survey Ireland Licence No. EN0034515.
2. All dimensions in millimetres.
3. Design for Planning Purposes, not for Construction.

Key to symbols

2	Gantry
3	Surge Arrestor
4	Cable sealing end
8	Overhead Line conductor
	220kV Cable sealing end compound fence (2.6m Palisade Fence)
	Property Fence (1.4m Concrete Post and Rail)
	220kV Cable
	Access Track

0 5m 10m 20m
1:200

Reference drawings

Rev	Date	Drawn	Description	Ch'k'd	App'd
03A	02/02/2016	CT	Issued for Planning	TK	TK
02A	29/01/2016	CT	Issued for Planning	TK	TK
01A	18/12/2015	CT	Issued for Planning	TK	TK

Mott MacDonald

South Block
Rockfield, Dundrum
Dublin, 16
Ireland

T +353 01-2916700
F +353 01-2916747
W www.mottmac.com

Client
Apple Distribution International

Title
Caraunduff 220kV Substation
Cable Sealing End Compound Layout
Cashla 1

Designed	D.McCormack	Eng check	T.Keane
Drawn	C.Thian	Coordination	D.McCormack
Dwg check	M.McCarthy	Approved	T.Keane

Scale at A1	Status	Rev	Security
1:200	APR	03A	STD

Drawing Number
MMD-360988-E-DR-01-XX-9201

© Mott MacDonald

This document is issued for the party which commissioned it and for specific purposes connected with the captioned project only. It should not be relied upon by any other party or used for any other purpose.
We accept no responsibility for the consequences of this document being relied upon by any other party, or being used for any other purpose, or containing any error or omission which is due to an error or omission in data supplied to us by other parties.

P:\Dublin\MPD\360988 - Data Centre (Temp for CAD Files)\02 Temp Working Files\Planning Drawings\MMD-360988-E-DR-01-XX-9201_03A.dwg Feb 1, 2016 - 3:10PM thi73557