


NORTH

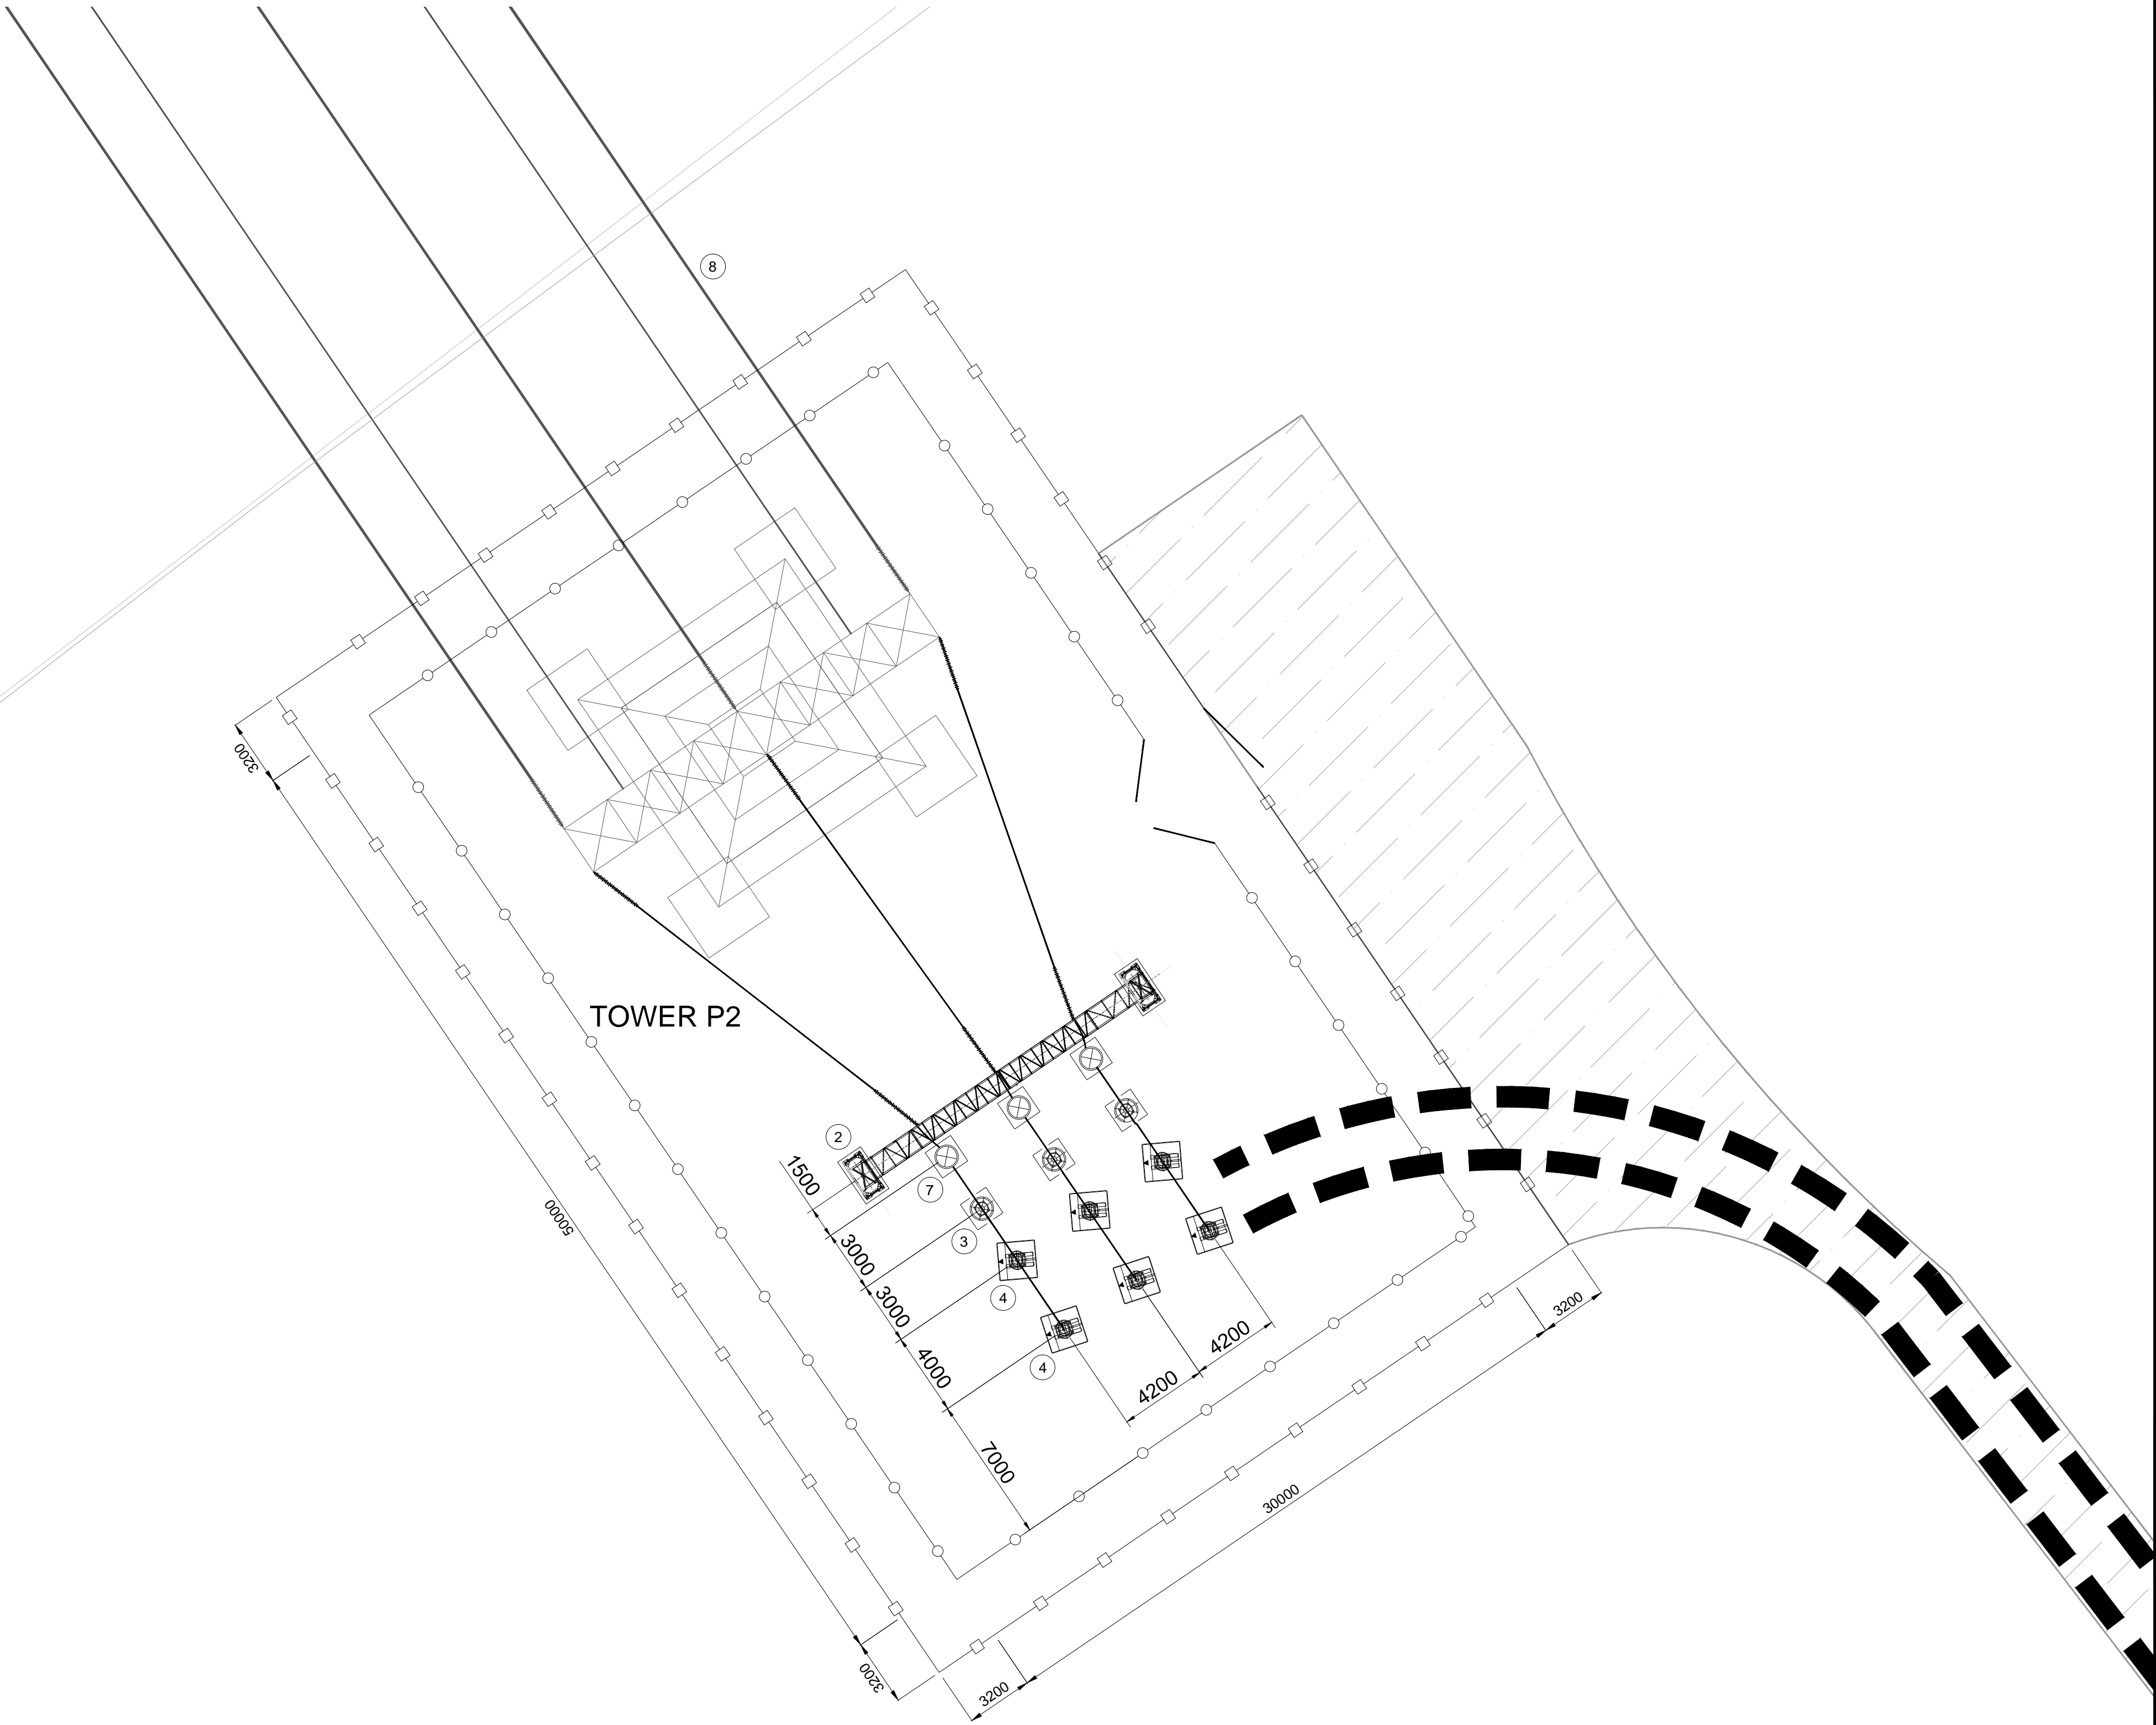

Notes

- ©Ordnance Survey Ireland/Government of Ireland. Ordnance Survey Ireland Licence No. EN0034515.
- All dimensions in millimetres.
- Design for Planning Purposes, not for Construction.

Key to symbols

2	Gantry
3	Surge Arrestor
4	Cable sealing end
7	Line Trap
8	Overhead Line conductor
	220kV Cable sealing end compound fence (2.6m Palisade Fence)
	Property Fence (1.4m Concrete Post and Rail)
	220kV Cable
	Access Track

0 5m 10m 20m  
1:200

Reference drawings

03A	02/02/2016	CT	Issued for Planning	TK	TK
02A	29/01/2016	CT	Issued for Planning	TK	TK
01A	18/12/2015	CT	Issued for Planning	TK	TK
Rev	Date	Drawn	Description	Ch'k'd	App'd

South Block  
Rockfield, Dundrum  
Dublin, 16  
Ireland

T +353 01-2916700  
F +353 01-2916747  
W www.mottmac.com

Client

Apple Distribution International

Title

Caraunduff 220kV Substation  
Cable Sealing End Compound Layout  
Cashla 2

Designed	D.McCormack	Eng check	T.Keane
Drawn	C.Thian	Coordination	D.McCormack
Dwg check	M.McCarthy	Approved	T.Keane
Scale at A1	Status	Rev	Security
1:200	APR	03A	STD

Drawing Number

MMD-360988-E-DR-01-XX-9202