


NORTH

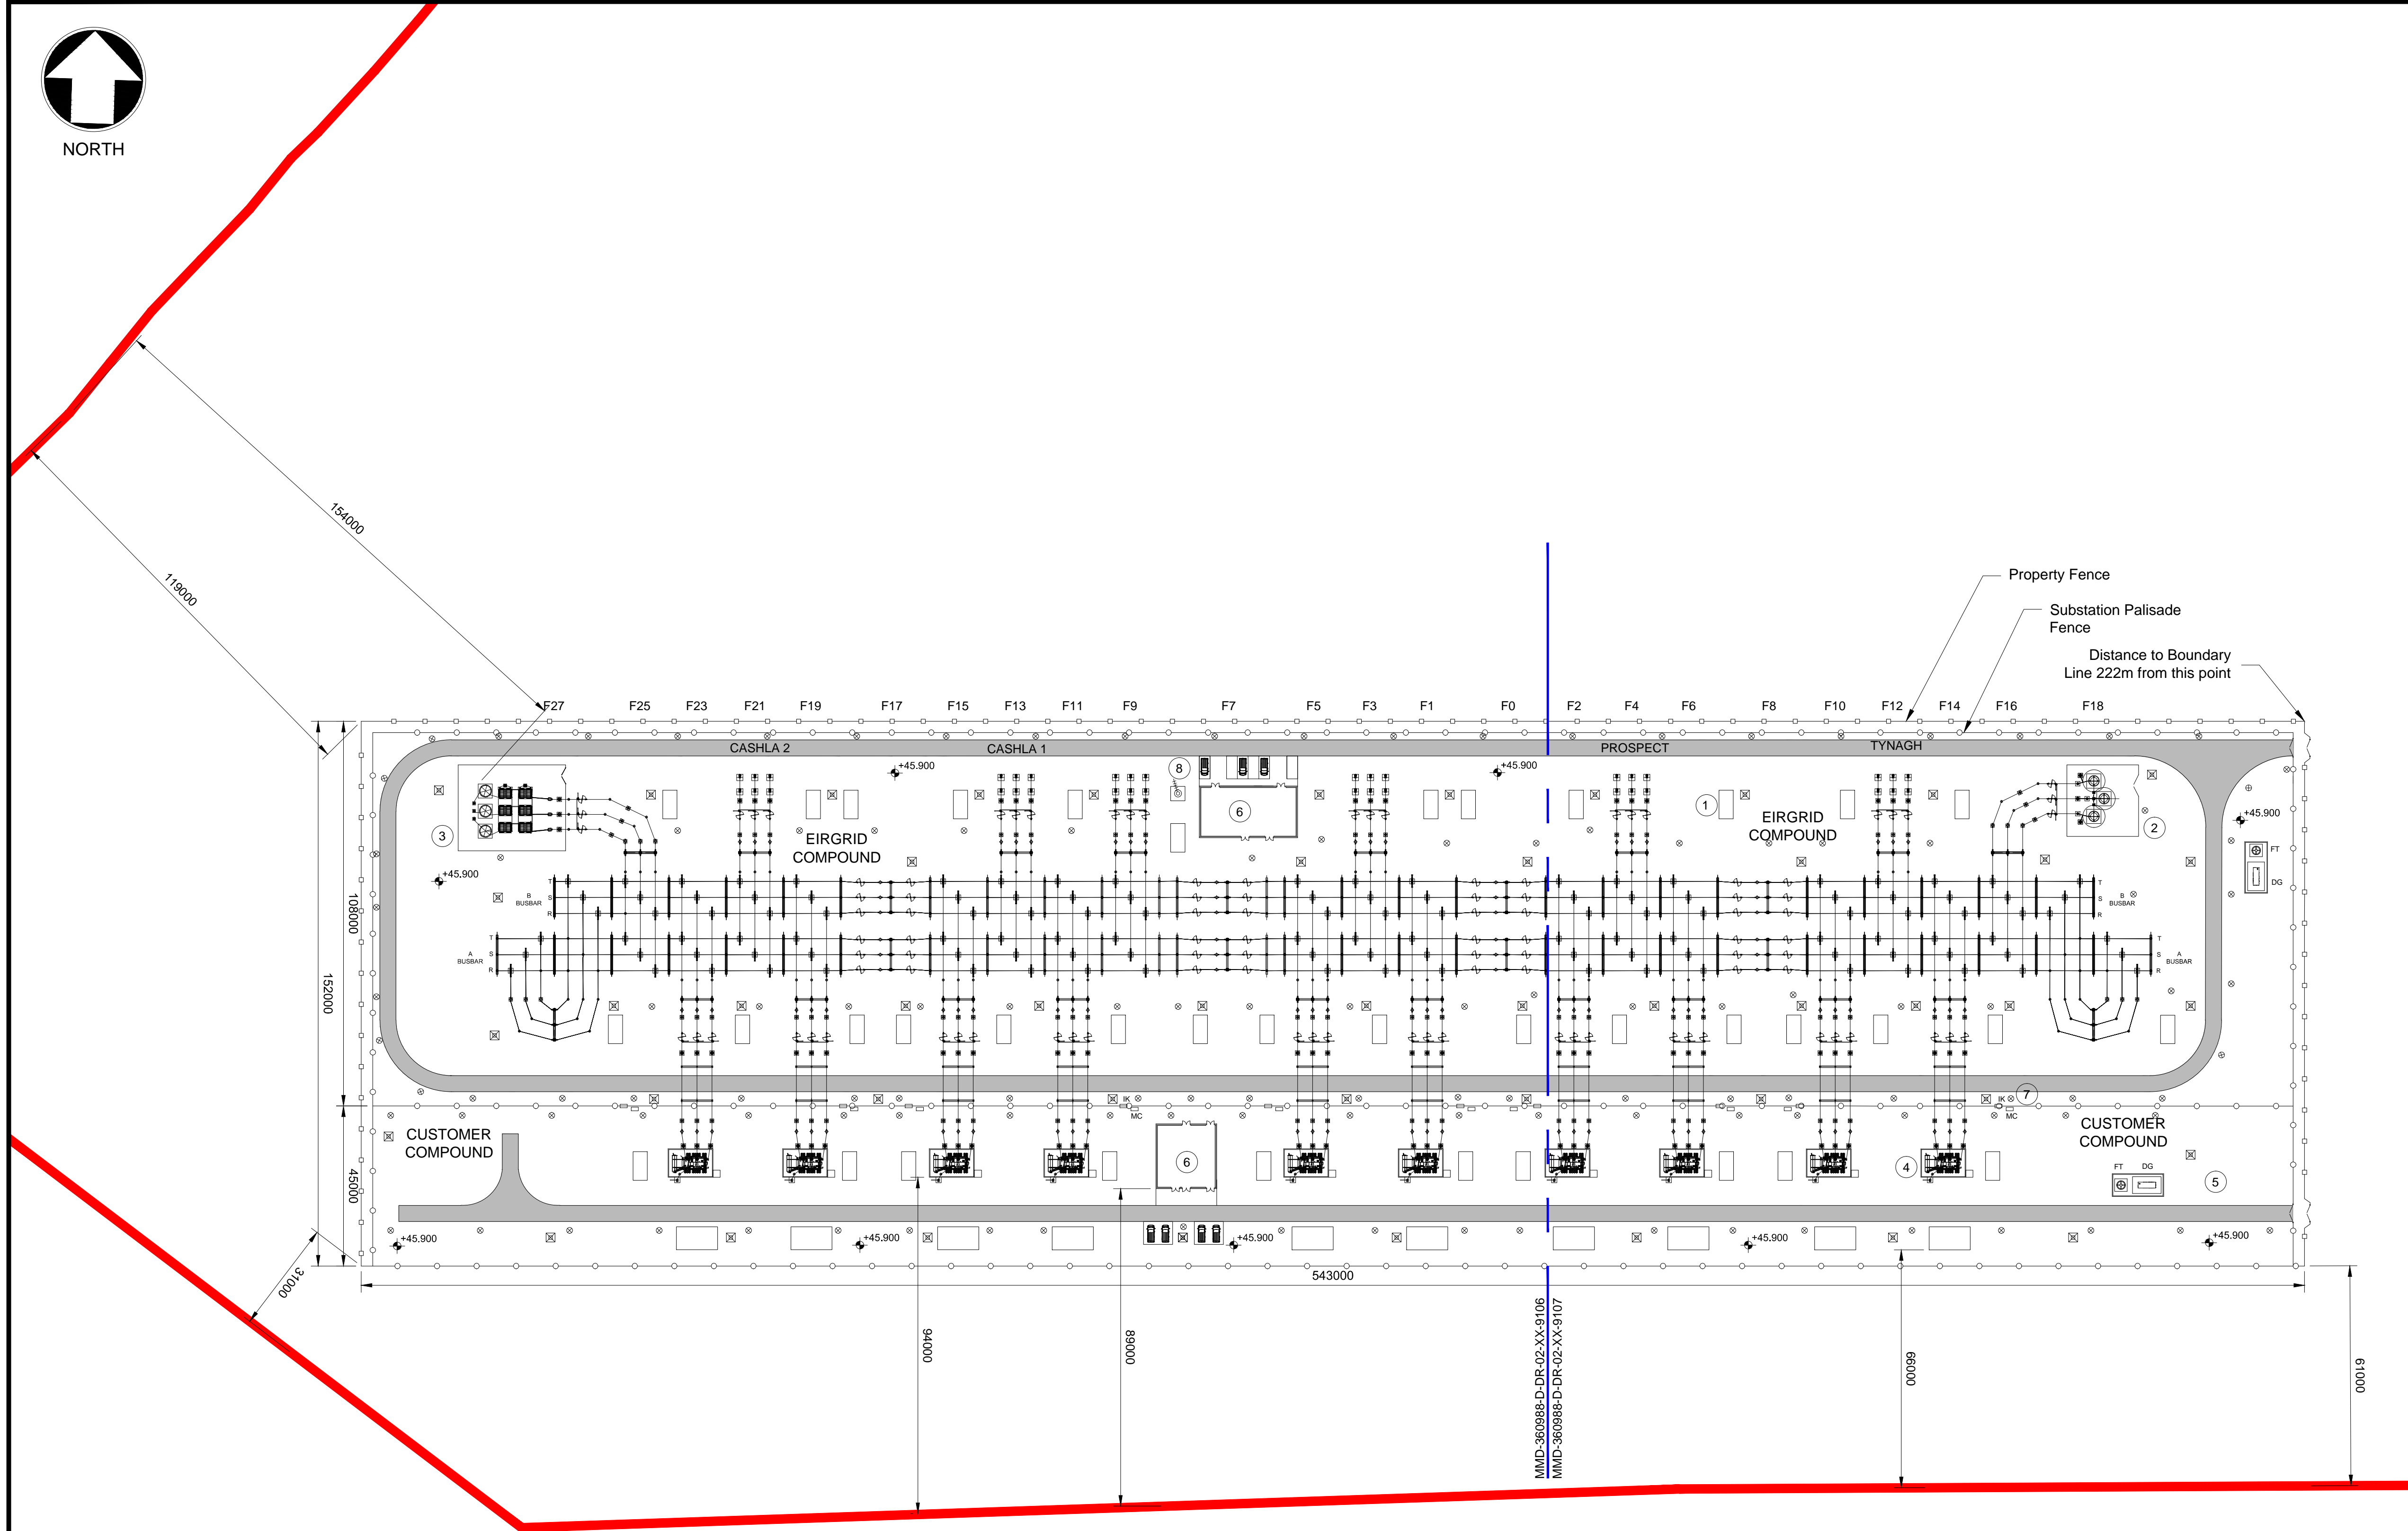


Notes

1. Design for Planning Purposes, not for Construction.
2. All levels shown are based on OS datum, Malin Head.
3. All dimensions in mm unless otherwise stated.

Key to symbols

- ① Control/Switchgear Cabin
- ② Reactive compensation
- ③ Harmonic Filter
- ④ 220/20kV Transformer
- ⑤ Emergency Diesel Generator and Fuel Tank
- ⑥ Control Building
- ⑦ Interface Kiosk and Metering Cabinet
- ⑧ Communications mast
- ⊠ 30 Metre Lighting Mast
- ⊗ Lighting Column
- Property Fence (1.4m Concrete Post and Rail)
- Substation Palisade Fence (2.6m with Electrified Fence Installed on Internal Side)
- SID Application Site Boundary

Reference drawings



03A	02/02/2016	CT	Issued for Planning	TK	TK
02A	29/01/2016	CT	Issued for Planning	TK	TK
01A	18/12/2015	CT	Issued for Planning	TK	TK
Rev	Date	Drawn	Description	Ch'k'd	App'd



South Block
Rockfield, Dundrum
Dublin, 16
Ireland
T +353 01-2916700
F +353 01-2916747
W www.mottmac.com

Client
Apple Distribution International

Title
Caraunduff 220kV Substation
Overall Substation Layout

Designed	D.McCormack	Eng check	T.Keane	
Drawn	C.Thian	Coordination	D.McCormack	
Dwg check	M. McCarthy	Approved	T.Keane	
Scale at A1	Status	Rev	Security	
1:1000	APR	03A	STD	

Drawing Number
MMD-360988-E-DR-02-XX-9105