




SECTION A

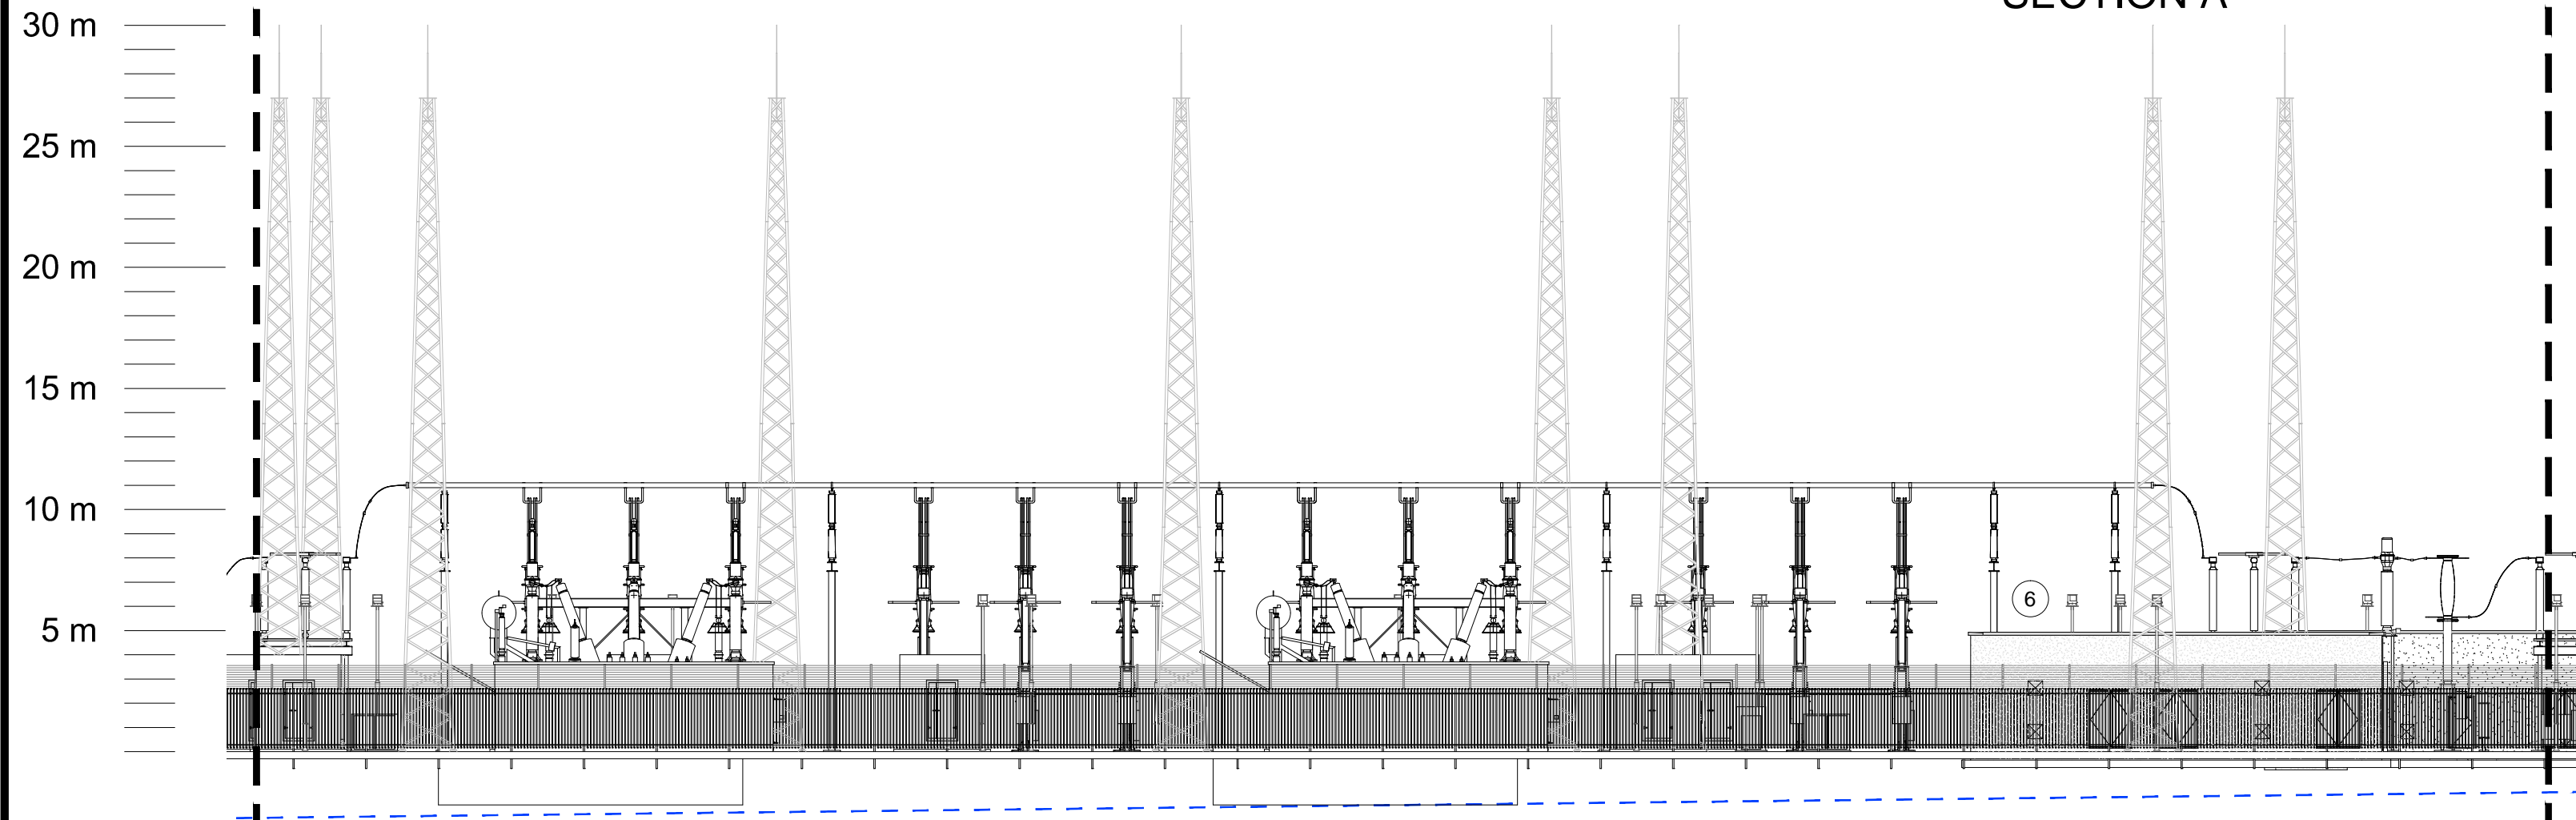


SECTION B

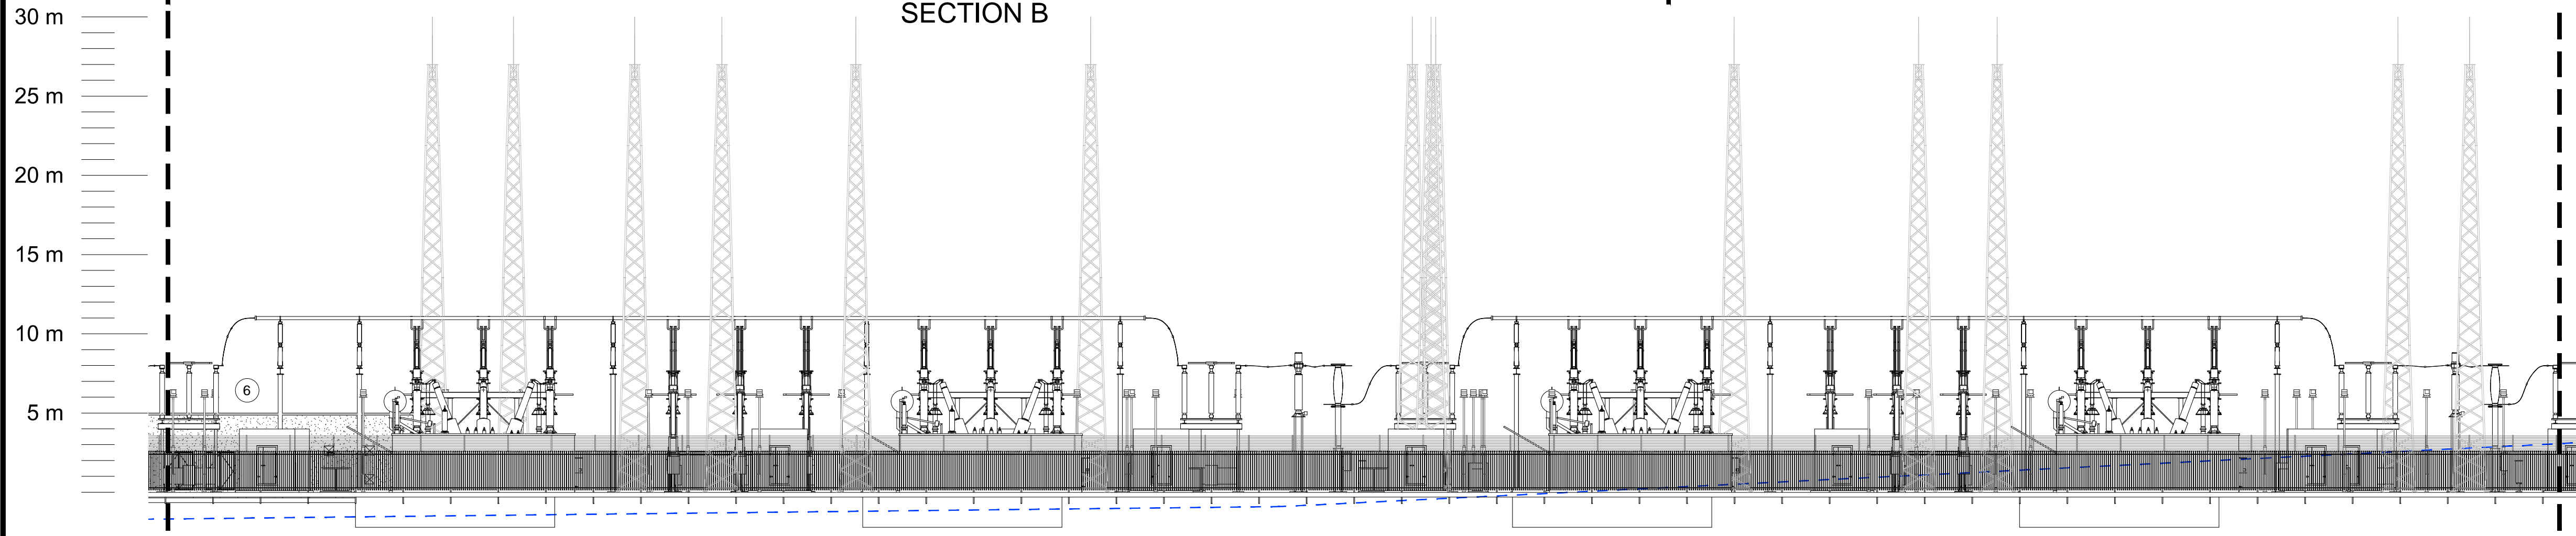

SECTION C

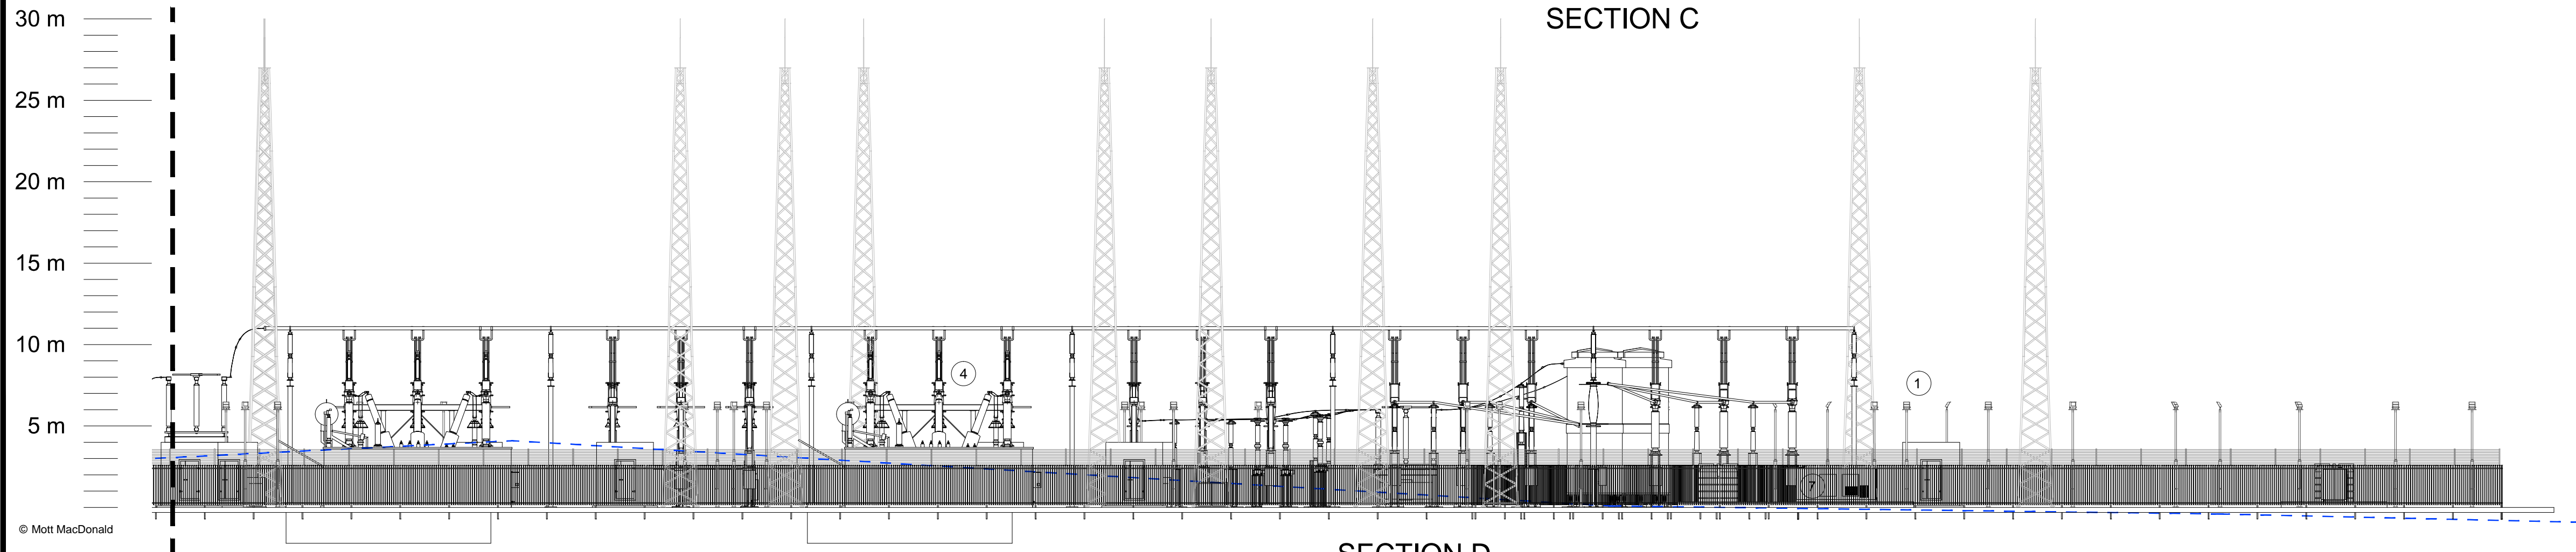

SECTION D

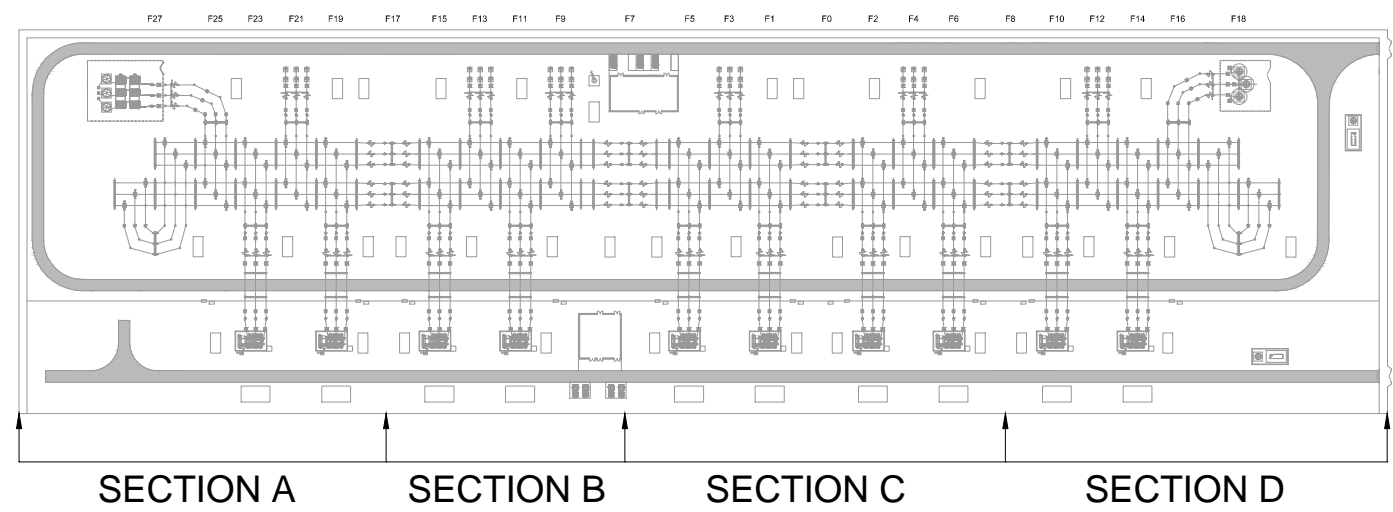


Notes

1. Finished ground level is 45.900m throughout the substation and is shown relative to OS Datum, Malin Head.
2. Design for Planning Purposes, not for Construction.

Key to symbols

- 1 Control/Switchgear Cabin
- 3 Harmonic Filter
- 4 220/20kV Transformer
- 6 Control Building
- 7 Interface Kiosk and Metering Cabinet
- Original Ground Level



Reference drawings

02A	29/01/2016	CT	Issued for Planning	TK	TK
01A	18/12/2015	CT	Issued For Planning	TK	TK
Rev	Date	Drawn	Description	Ch'k'd	App'd



South Block
Rockfield, Dundrum
Dublin, 16
Ireland
T +353 01-2916700
F +353 01-2916747
W www.mottmac.com

Client Apple Distribution International

Title Caraunduff 220kV Substation

South Elevation

Designed	D.McCormack	Eng check	T.Keane
Drawn	C.Thian	Coordination	D.McCormack
Dwg check	M.McCarthy	Approved	T.Keane
Scale at A1	Status	Rev	Security
1:250	APR	02A	STD

Drawing Number
MMD-360988-E-DR-02-XX-9109