



SECTION A

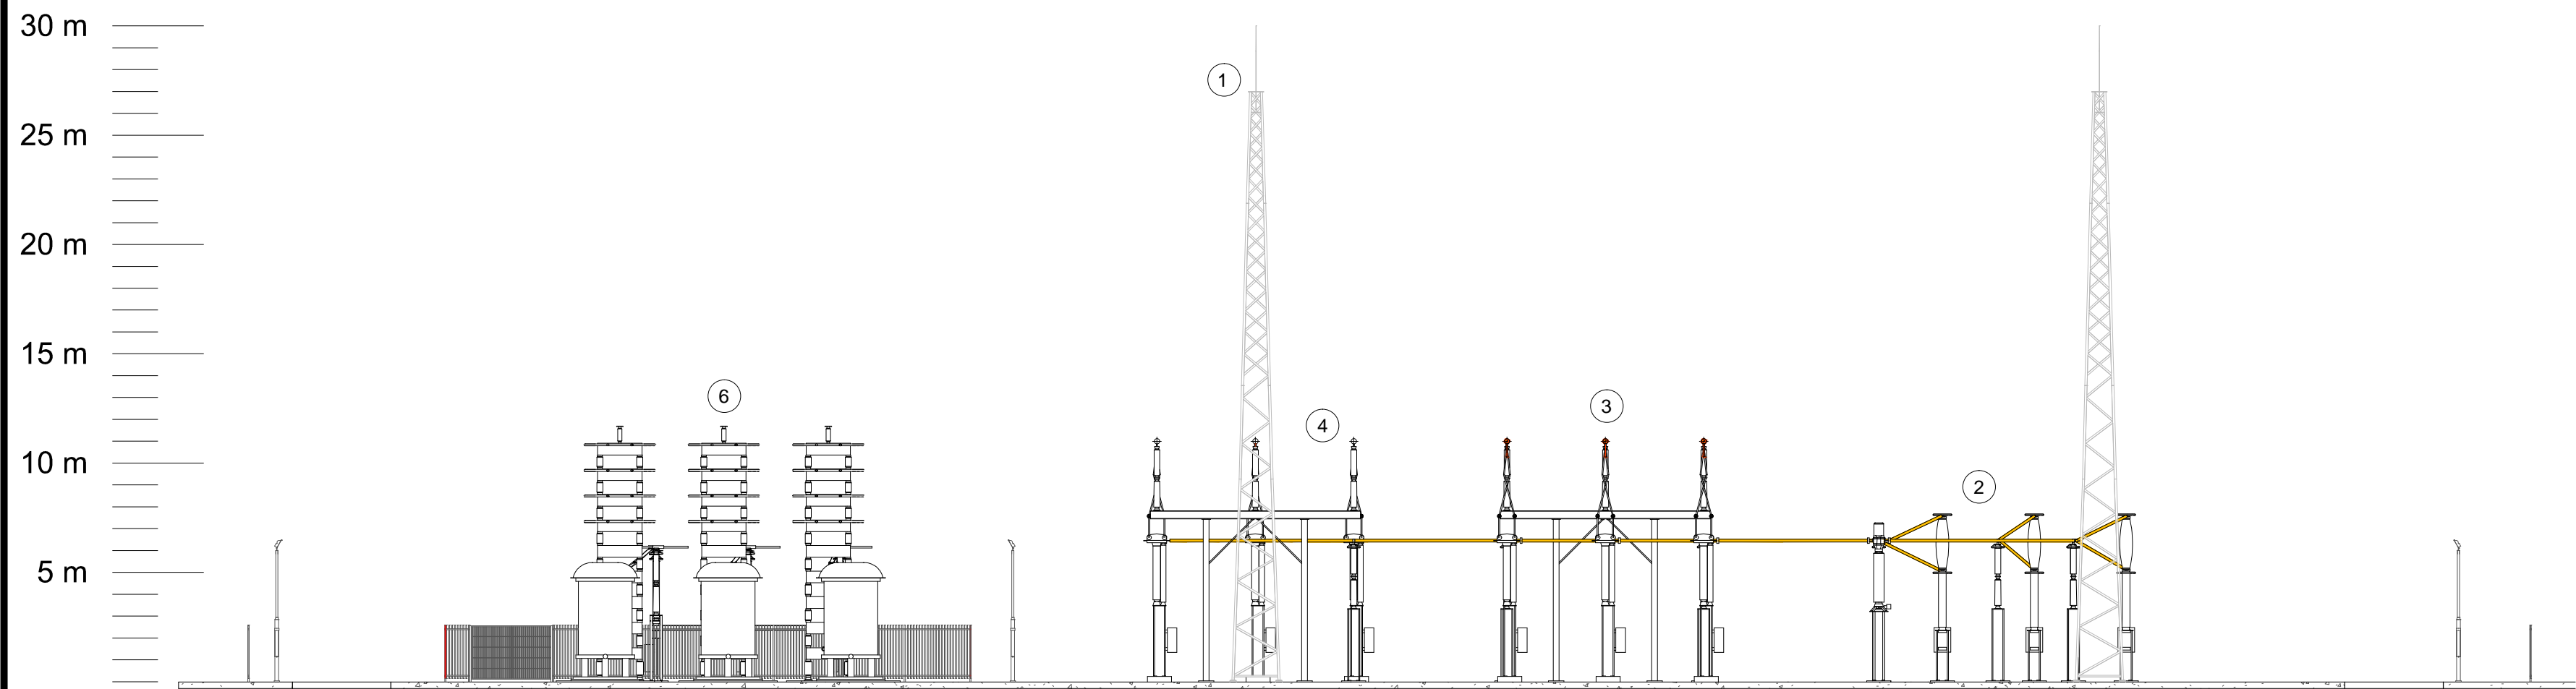


SECTION B

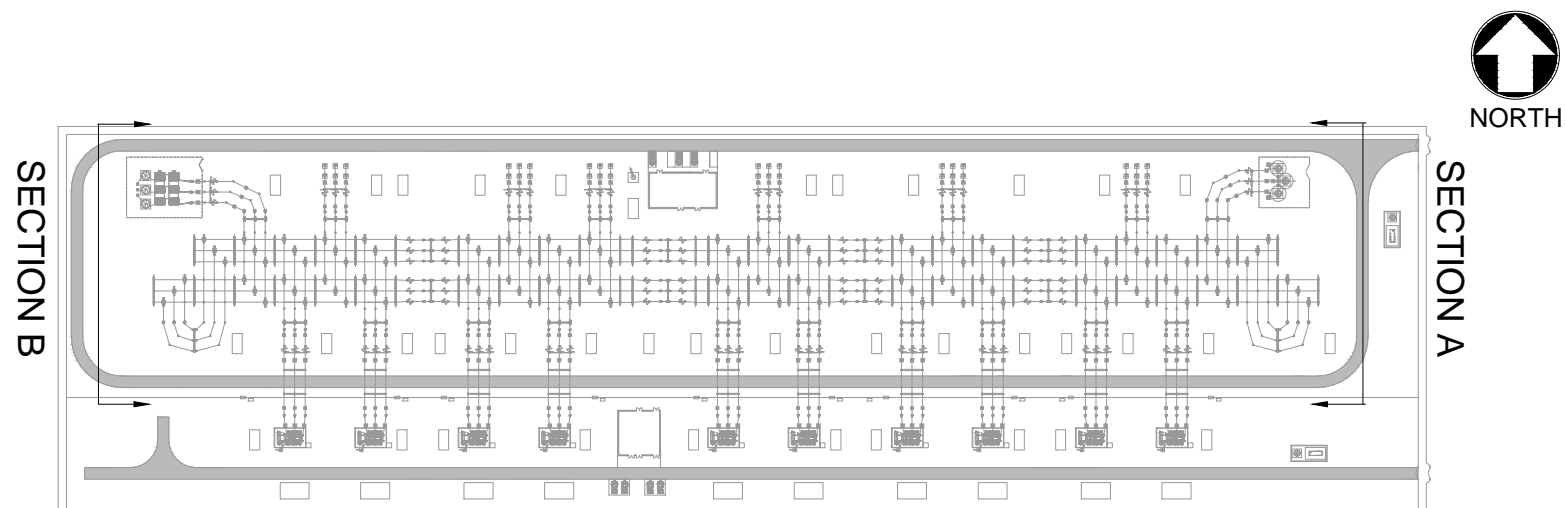

- Notes
1. Design for Planning Purposes, not for Construction.
 2. Finished ground level is 45.900m throughout the substation and is shown relative to OS Datum, Malin Head.

- Key to symbols
- ① Lightning Mast
 - ② Bus Coupler Bay
 - ③ A Busbars
 - ④ B Busbars
 - ⑤ Reactive Compensation Bay
 - ⑥ Harmonic Filter Bay



Reference drawings

02A	29/01/2016	CT	Issued for Planning	TK	TK
01A	18/12/2015	CT	Issued for Planning	TK	TK
Rev	Date	Drawn	Description	Ch'k'd	App'd



South Block
Rockfield, Dundrum
Dublin, 16
Ireland
T +353 01-2916700
F +353 01-2916747
W www.mottmac.com

Client
Apple Distribution International

Title
Caraunduff 220kV Substation

Sections - Sheet 1 of 2
Bus Couplers

Designed	D.McCormack	Eng check	T.Keane	
Drawn	C.Thian	Coordination	D.McCormack	
Dwg check	M.McCarthy	Approved	T.Keane	
Scale at A1	Status	Rev	Security	
1:250	APR	02A	STD	
Drawing Number MMD-360988-E-DR-02-XX-9111				